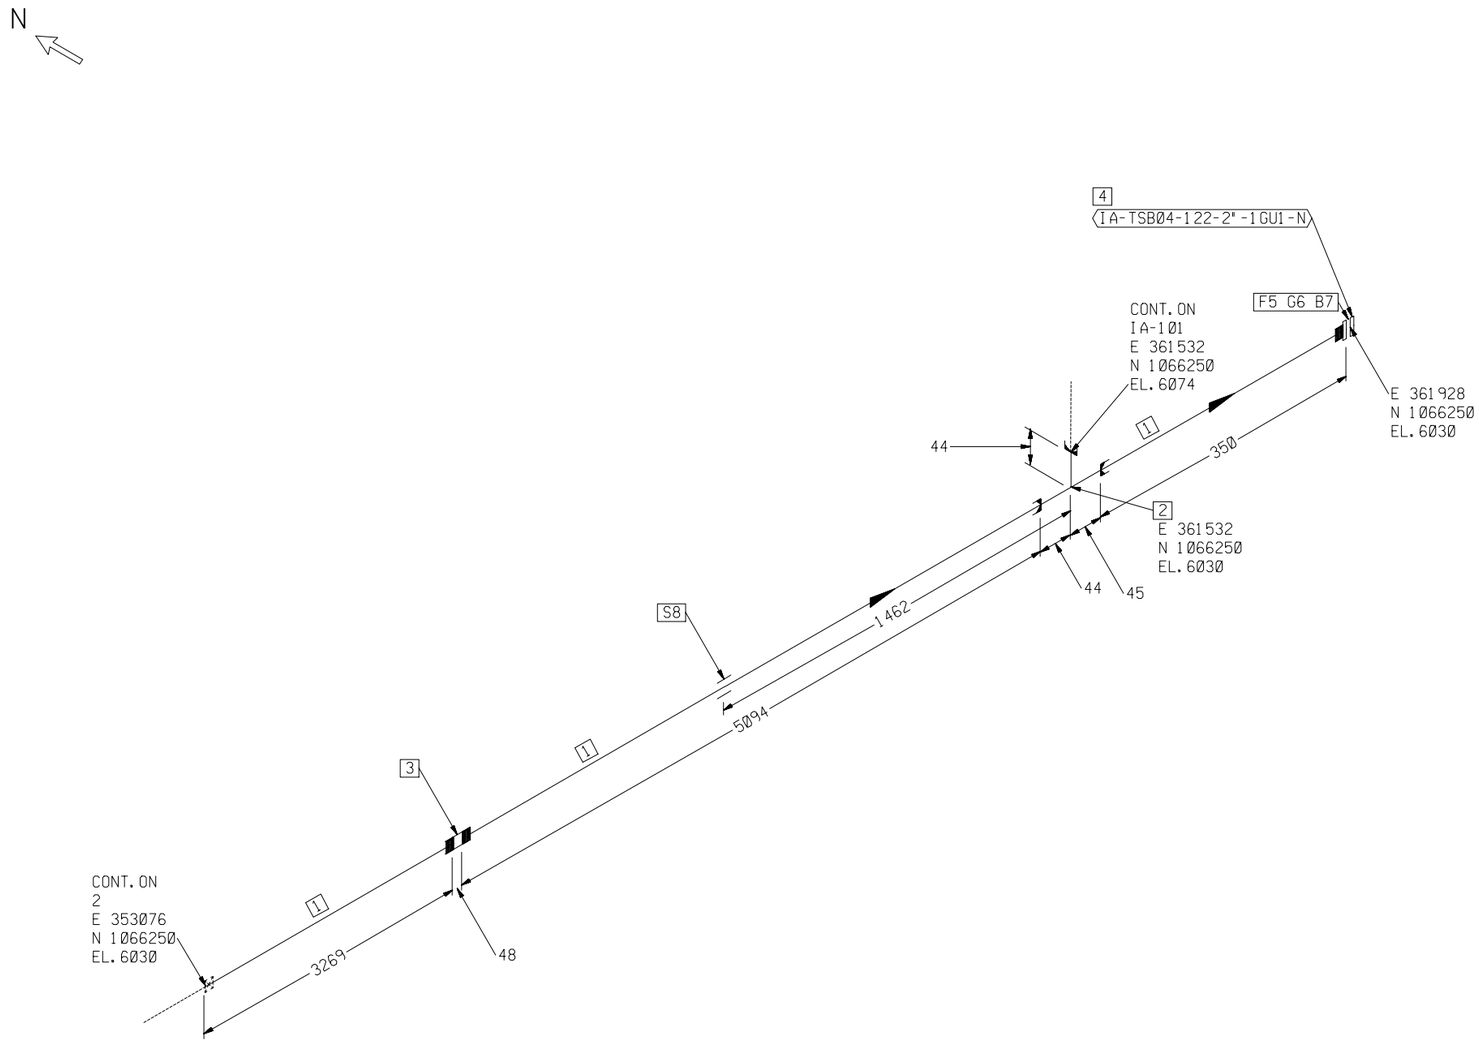


ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	NB (IN)	ITEM CODE	QTY
	PIPE			
1	2" SCH80 PIPE SMLS. THREADED CS ASTM A53-B. GALVANISED PER ASTM A153 DIMS TO ASME B36.10M	2	PP02521	8706
	FITTINGS			
2	2" TEE EQUAL THREADED CL3000 CS ASTM A105. GALVANISED PER ASTM A153 DIMS TO ASME B16.11	2X2	PT08834	1
3	2" COUPLING THREADED CL3000 CS ASTM A105. GALVANISED PER ASTM A153 DIMS TO ASME B16.11	2	PK00335	1
	FLANGES			
4	2" FLANGE BLIND CL150 FF CS ASTM A105. GALVANISED PER ASTM A153 DIMS TO ASME B16.5	2	PF08087	1
5	2" FLANGE THREADED CL150 FF CS ASTM A105. GALVANISED PER ASTM A153 DIMS TO ASME B16.5	2	PF08287	1
	GASKETS			
6	2" GASKET. FLAT RING. CL150 1.5MM (1/16") NOM THK NITRILE RUBBER DIMS TO ASME B16.5	2	PI00053	1
	BOLTS			
7	5/8" DIA * 85.0MM LG STUDBOLT ALLOY STEEL HOT DIPPED GALVANISED ASTM A193-B7. NUTS ASTM A194-2H., 85.0MM BOLT LENGTH	5/8	PB02225	4
	SUPPORTS			
8	PIPING SUPPORT	2	N-1134	1

操作压力(MPaG) OPT. PRESS.	操作温度(℃) OPT. TEMP.	设计压力(MPaG) DESIGN PRESS.	设计温度(℃) DESIGN TEMP.	试验压力(MPaG) TEST PRESS.	试验介质 TEST SERVICE.	
0.9	AMB	1.10	65	1.65	HYDROSTATIC	
所在P&ID图号 P&ID DRAWING NO.	所在模型号 PDS MODEL NO.	探伤(%) RT/UT	应力消除(Y/N) STRESS RELIEVE	涂漆等级 PAINT. CLASS	绝热类型/厚度(mm) INSULAT. CLASS/THK	
PR-04006	/	RT 5	N	SYSTEM 6	N	0

修改 REV.	版次 ISSUE	发布日期 DATE	发布说明 DESCRIPTION	设计 DESIGNED	校核 CHECKED	审核 APPROVED	审定 AUTHORIZED
0	0	2013-10-31	供施工	CG	YJS		

专业 DISCIPLINE	会签及日期 COUNTERSIGNED & DATE	修改 REVISED	日期 DATE	设计 DESIGNED	校核 REVIEWED	审核 APPROVED

中海福建天然气有限责任公司
CNOOC-Fujian LNG Co.,Ltd.

东华工程科技股份有限公司
EAST CHINA ENGINEERING SCIENCE AND TECHNOLOGY CO.,LTD.

设计 DESIGED		IA-TSB04-122-2"-1GU1-N	
制图 DRAWN		管道轴测图	
校核 CHECKED		ISOMETRICS DRAWING	
审核 APPROVED		压力管道类别 GC2	
审定 AUTHORIZED		比例 SCALE / 版次 ISSUE 0	

合同号 Contract	Z2012SLFJ-TS/E-S085-01
文件编号 Ref.No.	FJPTTSB-DD-DWG-TS-PI-04332
工程 PROJ.	福建LNG站线项目 秀屿接收站新增槽车装车站工程
装置 JOB	168/010
工序 SUB. JOB	/
设计阶段 DES. PHASE	详细设计
	201205SB-168/010-040E-232 Ø
入库日期 DATE	第 SHEET NO 1 张共 OF 7 张 修改 REV.

本图纸仅供本项目使用，未经东华工程科技股份有限公司许可不得转给第三者
THIS DRAWING SHALL BE USED FOR THIS PROJECT ONLY, TRANSFER TO ANY THIRD PARTY WITHOUT ECEC'S CONSENT IS NOT PERMITTED.