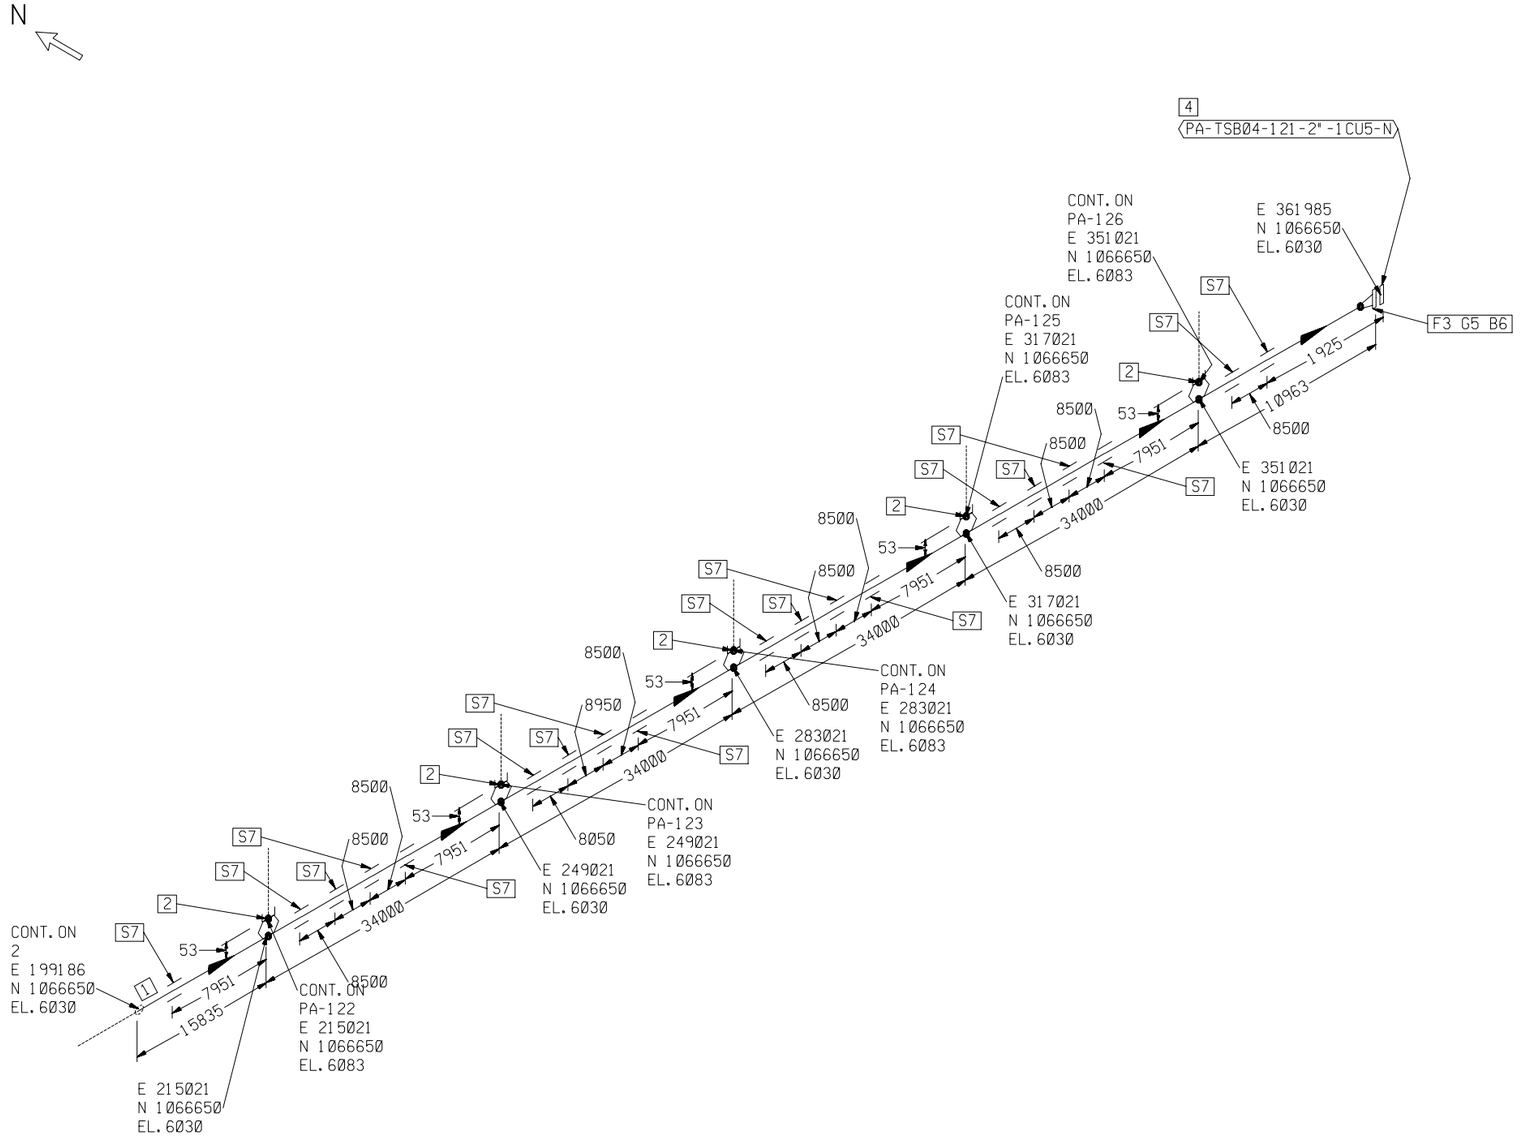


FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	NB (IN)	ITEM CODE	QTY
	PIPE			
1	2" SCH40 PIPE SMLS. BE CS API 5L-B. DIMS TO ASME B36.10M	2	PP00338	162734
	FITTINGS			
2	2" * 1" SOCKOLET CL3000 CS ASTM A105. DIMS TO MSS SP-97/ASME B31.3	2X1	PO10550	5
	FLANGES			
3	2" SCH40 FLANGE WN CL150 RF CS ASTM A105. DIMS TO ASME B16.5	2	PF01691	1

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	NB (IN)	ITEM CODE	QTY
	FLANGES			
4	2" FLANGE BLIND CL150 RF CS ASTM A105. DIMS TO ASME B16.5	2	PF01543	1
	GASKETS			
5	2" GASKET. FLAT RING. CL150 1.5MM (1/16") NOM THK COMPRESSED NON ASBESTOS FIBRE DIMS TO ASME B16.5	2	PG00040	1
	BOLTS			
6	5/8" DIA * 85.0MM LG STUDBOLT ALLOY STEEL ASTM A193-B7. NUTS ASTM A194-2H., 85.0MM BOLT LENGTH	5/8	PB01989	4
	SUPPORTS			
7	PIPING SUPPORT	2	N-1132	19

操作压力(MPaG) OPT. PRESS.	操作温度(℃) OPT. TEMP.	设计压力(MPaG) DESIGN PRESS.	设计温度(℃) DESIGN TEMP.	试验压力(MPaG) TEST PRESS.	试验介质 TEST SERVICE.	
0.9	AMB	1.10	65	1.65	HYDROSTATIC	
所在P&ID图号 P&ID DRAWING NO.	所在模型号 PDS MODEL NO.	探伤(%) RT/UT	应力消除(Y/N) STRESS RELIEVE	涂漆等级 PAINT. CLASS	绝热类型/厚度(mm) INSULAT. CLASS/THK	
PR-04006	/	RT 5	N	SYSTEM 1	N	Ø

修改 REV.	版次 ISSUE	发布日期 DATE	发布说明 DESCRIPTION	设计 DESIGNED	校核 CHECKED	审核 APPROVED	审定 AUTHORIZED
Ø	Ø	2013-10-31	供施工	CG	YJS		

DISCIPLINE 专业	COUNTERSIGNED & DATE 会签及日期	REVISED 修改	DATE 日期	DESIGNED 设计	REVIEWED 校核	APPROVED 审核

中海福建天然气有限责任公司
CNOOC-Fujian LNG Co.,Ltd.

东华工程科技股份有限公司
EAST CHINA ENGINEERING SCIENCE AND TECHNOLOGY CO.,LTD.

合同号 Contract	Z2012SLFJ-TS/E-S085-01		
文件编号 Ref.No.	FJPTTSB-DD-DWG-TS-PI-04342		
工程 PROJ.	福建LNG站线项目 秀屿接收站新增槽车装车站工程		
装置 JOB	168/010		
工序 SUB. JOB	/		
设计阶段 DES. PHASE	详细设计		

PA-TSB04-121-2"-1CU5-N
管道轴测图
ISOMETRICS DRAWING

设计 DESIGED			压力管道类别	GC2		
制图 DRAWN						
校核 CHECKED						
审核 APPROVED						
审定 AUTHORIZED			比例 SCALE		版次 ISSUE	Ø

201205SB-168/010-040E-242 Ø

入库日期 DATE | 第 SHEET NO 1 张共 OF 3 张 | 修改 REV

本图纸仅供本项目使用，未经东华工程科技股份有限公司许可不得转给第三者
THIS DRAWING SHALL BE USED FOR THIS PROJECT ONLY, TRANSFER TO ANY THIRD PARTY WITHOUT ECEC'S CONSENT IS NOT PERMITTED.