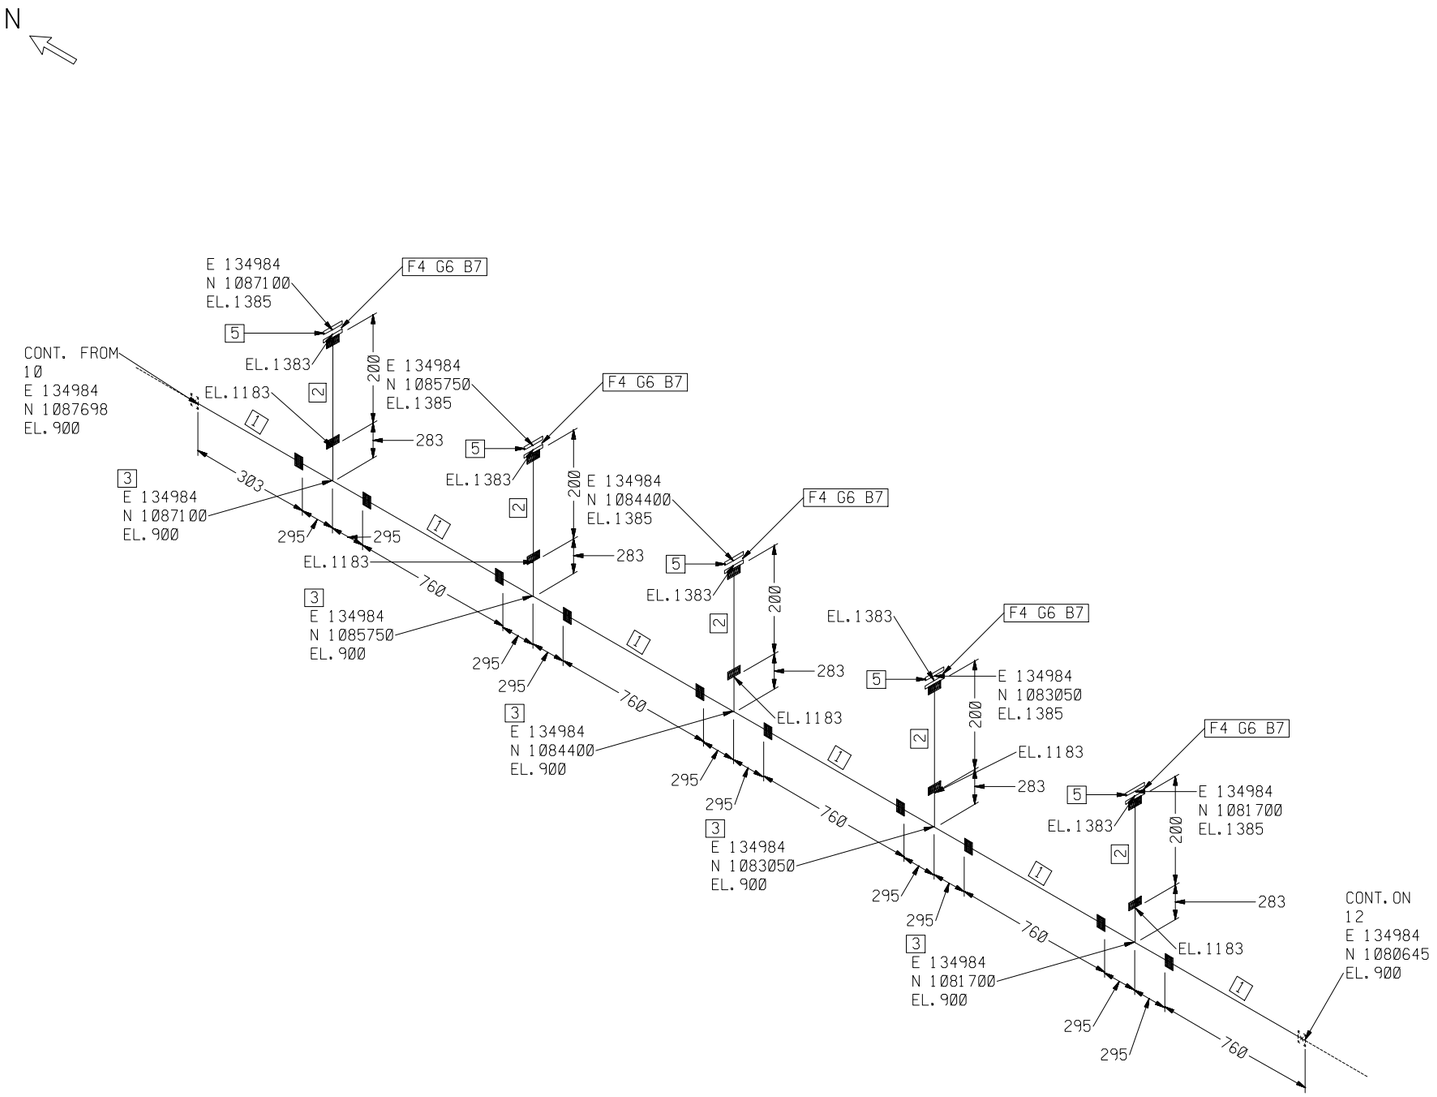


ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	NB (IN)	ITEM CODE	QTY
	PIPE			
1	16" PIPE - NON METALLIC GRE. FIREPROOF MALE/FEMALE MECHANICAL JOINT API 15LR OR EQUAL 20 BARG	16	PP02764	4103
2	8" PIPE - NON METALLIC GRE. FIREPROOF MALE/FEMALE MECHANICAL JOINT API 15LR OR EQUAL 20 BARG	8	PP02760	1000
	FITTINGS			
3	16" * 8" TEE BRANCH REDUCING GRE. FIREPROOF TAPER JOINT API 15LR 20 BARG	16X8	PT12841	5
	FLANGES			
4	8" HEAVY DUTY FLANGE FIREPROOF GRE. TAPER JOINT API 15LR CL150 FF	8	PF09173	5
5	8" BLIND FLANGE FIREPROOF GRE. API 15LR OR EQUAL CL150 FF	8	PF08862	5
	GASKETS			
6	8" GASKET. FULL FACE. CL150 1.5MM (1/16") NOM THK NITRILE RUBBER DIMS TO ASME B16.5	8	PG00072	5
	BOLTS			
7	3/4" DIA * 200.0MM LG STUDBOLT ALLOY STEEL HOT DIPPED GALVANISED ASTM A193-B7. NUTS ASTM A194-2H., 200.0MM BOLT LENGTH	3/4	PB07135B	40

操作压力(MPaG) OPT. PRESS.	操作温度(℃) OPT. TEMP.	设计压力(MPaG) DESIGN PRESS.	设计温度(℃) DESIGN TEMP.	试验压力(MPaG) TEST PRESS.	试验介质 TEST SERVICE.	
1.3	AMB	2.0	0-65	2.4	HYDROSTATIC	
所在P&ID图号 P&ID DRAWING NO.	所在模型号 PDS MODEL NO.	探伤(%) RT/UT	应力消除(Y/N) STRESS RELIEVE	涂漆等级 PAINT. CLASS	绝热类型/厚度(mm) INSULAT. CLASS/THK	
	/	/			/	/

修改 REV.	版次 ISSUE	发布日期 DATE	发布说明 DESCRIPTION	设计 DESIGNED	校核 CHECKED	审核 APPROVED	审定 AUTHORIZED
0	0	2013-12-20	供施工	QCC	SYP		

专业 DISCIPLINE	会签及日期 CONTERSIGNED & DATE	修改 REVISED	日期 DATE	设计 DESIGNED	校核 REVIEWED	审核 APPROVED

中海福建天然气有限责任公司
CNOOC-Fujian LNG Co.,Ltd.

东华工程科技股份有限公司
EAST CHINA ENGINEERING SCIENCE AND TECHNOLOGY CO.,LTD.

设计 DESIGED		FW-TSB22-001-16"-1CU1-N	
制图 DRAWN		管道轴测图	
校核 CHECKED		ISOMETRICS DRAWING	
审核 APPROVED		压力管道类别 /	
审定 AUTHORIZED		比例 SCALE / 版次 ISSUE	

合同号 Contract	Z2012SLFJ-TS/E-S085
文件编号 Ref.No.	FJPTTSB-DD-DWG-TS-FW-22009
工程 PROJ.	福建LNG站线项目 秀屿接收站新增外输系统工程
装置 JOB	021
工序 SUB.JOB	/
设计阶段 DES.PHASE	详细设计
	201205SB-021-170E-02
入库日期 DATE	第 SHEET NO 11 张共 OF 13 张 修改 REV 0

本图纸仅供本项目使用，未经东华工程科技股份有限公司许可不得转给第三者
THIS DRAWING SHALL BE USED FOR THIS PROJECT ONLY, TRANSFER TO ANY THIRD PARTY WITHOUT ECEC'S CONSENT IS NOT PERMITTED.