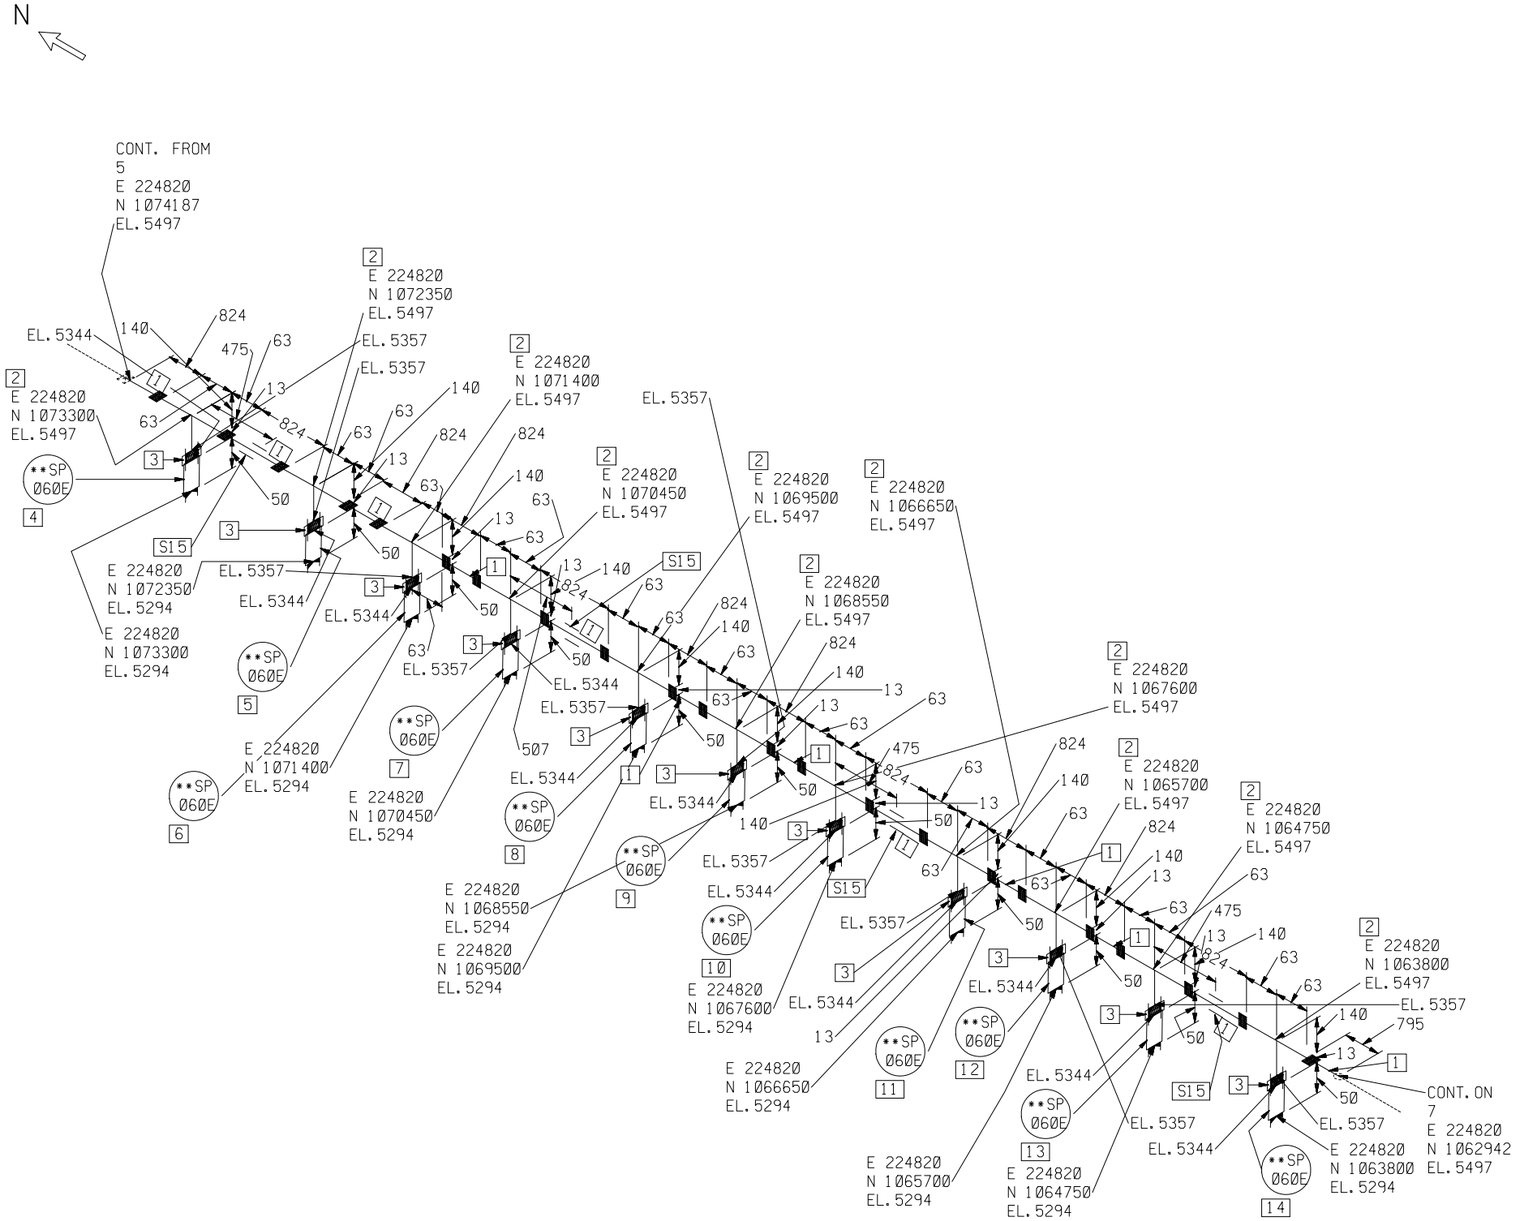


FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	NB (IN)	ITEM CODE	QTY
	PIPE			
1	CS ASTM A53-B. ASME B36.10M PIPE SMLS THRD SCH 80	6	T30P011	9859

ERECTION MATERIALS

PT NO	COMPONENT DESCRIPTION	NB (IN)	ITEM CODE	QTY
	FITTINGS			
2	PN25 DG GALV CJ/T 156-2001 ACC. ASME B36.10M TEE BRANCH REDUCING GROOVED /NPT THREAD	6X1	PT0T352	11
3	1" * 1/2" BUSH HEX HD RED. THD. CL3000 CS ASTM A105 ASME B16.11 GALV.	1	PI00103A	11
4	SEE PIPING MATERIAL DWG **SP060E	1/2		1
5	SEE PIPING MATERIAL DWG **SP060E	1/2		1
6	SEE PIPING MATERIAL DWG **SP060E	1/2		1
7	SEE PIPING MATERIAL DWG **SP060E	1/2		1
8	SEE PIPING MATERIAL DWG **SP060E	1/2		1
9	SEE PIPING MATERIAL DWG **SP060E	1/2		1
10	SEE PIPING MATERIAL DWG **SP060E	1/2		1
11	SEE PIPING MATERIAL DWG **SP060E	1/2		1
12	SEE PIPING MATERIAL DWG **SP060E	1/2		1
13	SEE PIPING MATERIAL DWG **SP060E	1/2		1
14	SEE PIPING MATERIAL DWG **SP060E	1/2		1
	SUPPORTS			
15	PIPING SUPPORT	6	N-3073	4

操作压力(MPaG) OPT. PRESS.	操作温度(℃) OPT. TEMP.	设计压力(MPaG) DESIGN PRESS.	设计温度(℃) DESIGN TEMP.	试验压力(MPaG) TEST PRESS.	试验介质 TEST SERVICE.	
0.55	AMB	0.9	0-65	1.1	HYDROSTATIC	
所在P&ID图号 P&ID DRAWING NO.	所在模型号 PDS MODEL NO.	探伤(%) RT/UT	应力消除(Y/N) STRESS RELIEVE	涂漆等级 PAINT. CLASS	绝热类型/厚度(mm) INSULAT. CLASS/THK	
FW-TSB-DD-DWG-TS-FW-22003 /					/	/

修改 REV	版次 ISSUE	发布日期 DATE	发布说明 DESCRIPTION	设计 DESIGNED	校核 CHECKED	审核 APPROVED	审定 AUTHORIZED
0	0	2013-12-20	供施工	QCC	SYP		

专业 DISCIPLINE	会签及日期 COUNTERSIGNED & DATE	修改 REVISED	日期 DATE	设计 DESIGNED	校核 REVIEWED	审核 APPROVED

中海福建天然气有限责任公司
CNOOC-Fujian LNG Co.,Ltd.

东华工程科技股份有限公司
EAST CHINA ENGINEERING SCIENCE AND TECHNOLOGY CO.,LTD.

合同号 Contract	Z2012SLFJ-TS/E-S085
文件编号 Ref.No.	FJPTTSB-DD-DWG-TS-FW-22057
工程 PROJ.	福建LNG站线项目 秀屿接收站新增外输系统工程
装置 JOB	168
工序 SUB. JOB	/
设计阶段 DES. PHASE	详细设计

设计 DESIGED		
制图 DRAWN		
校核 CHECKED		
审核 APPROVED		
审定 AUTHORIZED		

FW-TSB22-028-6"-1GU2-N
管道轴测图
ISOMETRICS DRAWING
压力管道类别 /
比例 SCALE
版次 ISSUE
201205SB-168-170E-41
Ø
入库日期 DATE
第 SHEET NO 7 张共 OF 10 张
修改 REV

本图纸仅供本项目使用，未经东华工程科技股份有限公司许可不得转给第三者
THIS DRAWING SHALL BE USED FOR THIS PROJECT ONLY, TRANSFER TO ANY THIRD PARTY WITHOUT ECEC'S CONSENT IS NOT PERMITTED.